



Photo © Valentin Luthiger

Play value

Little protected flasks are placed in stainless steel stations and these can be filled with a multitude of fragrances. They should be renewed every three months or, alternatively, the fragrances can be swapped at this time. This is especially recommended for residences for senior citizen: it can give rise to guessing games and conversations.


Recommended for

- Kindergarten children
- School children
- Young people
- Adults
- Older people
- Public play areas without supervision, such as playgrounds, parks or similar



Scented Organ



Vandalism	not vulnerable
Supervision	not necessary
Explanation Board	included
Installation	outdoors
Safety check (DIN EN 1176)	not necessary
Installation in concrete	possible



10.61000

Order No. 10.61000
Scented Organ

Safety distance →
 Device dimensions ●—●
 Functional distance —|—

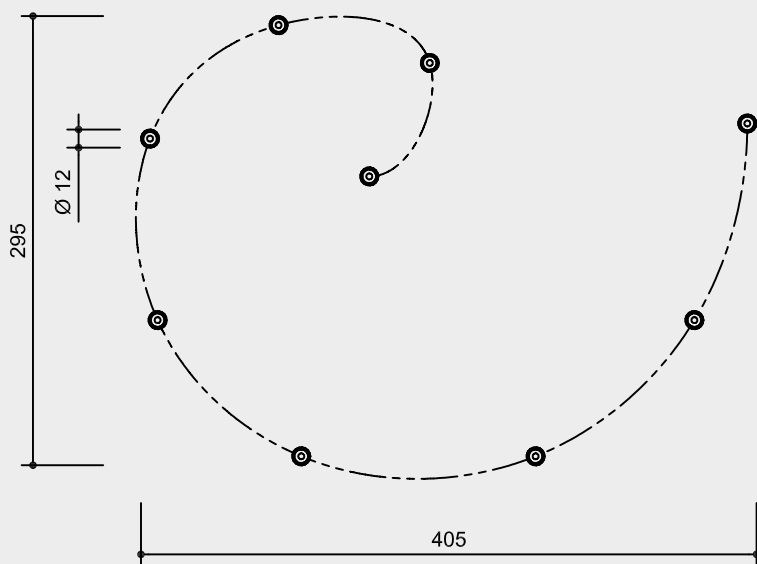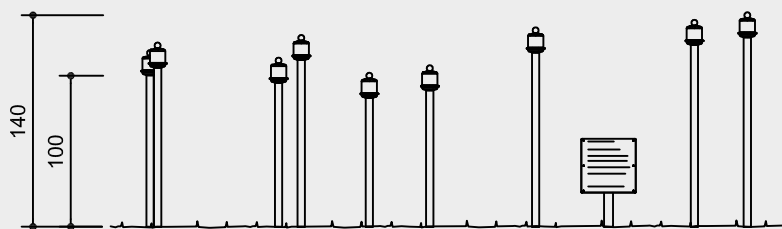

Scale 1:50

Technical information

Equipment made of stainless steel with openings for smelling

Ground anchor

All parts used for anchoring to the ground are made of hot-dip galvanised steel or stainless steel



For more detailed explanation of the quality characteristics see price list.

Unscrewable secured lid

Support for Explanation Board made of stainless steel

Dimensions

(small deviations possible)

Height	1.00 -1.40 m
Diameter	max. 0.12 m
Weight	60 kg

Components

- 9 Pillars with aromatic oils sufficient for a two year supply
- 1 Explanation Board with support for dowelling and 2 heavy duty anchors

Trademark

30 2005 500 000 Germany
 40-0682207 South Korea

Installation information


Recommended space
 5.00 x 4.00 m

Foundations
 9 items 50 x 50 x 40 cm
 Excavation depth 60 cm

Explanation Board
 1 item 40 x 40 x 40 cm
 Excavation depth 60 cm

Attention:
Exact measurements may vary;
for all installation dimensions refer
to current assembly instructions.
 Technical changes reserved.

The depicted arrangement of the pillars is just a proposal.
 It is possible to order a different number of pillars. Minimum order number: 3



10.61000